



Contents lists available at ScienceDirect

Optical Fiber Technology

www.elsevier.com/locate/yofte



Optical sensing in high voltage transmission lines using power over fiber and free space optics



João Batista Rosolem*, Fabio Renato Bassan, Rivaél Strobel Penze, Ariovaldo Antonio Leonardi, João Paulo Vicentini Fracarolli, Claudio Florida

CPqD – Research & Development Center in Telecommunications, Campinas, SP 13086-902, Brazil

ARTICLE INFO

Article history:

Received 14 June 2015

Revised 3 September 2015

Available online 16 September 2015

Keywords:

Power over fiber

Free space optics

Electrical insulator

High voltage

Overhead transmission lines

Current sensing

ABSTRACT

In this work we propose the use of power over fiber (PoF) and free space optics (FSO) techniques to power and receive signals from an electrical current sensor placed at high voltage potential using a pair of optical collimators. The technique evaluation was performed in a laboratorial prototype using 62.5/125 μm multimode fiber to study the sensitivity of the optical alignment and the influence of the collimation process in the sensing system wavelengths: data communication (1310 nm) and powering (830 nm). The collimators were installed in a rigid electric insulator in order to maintain the stability of transmission.

© 2015 Elsevier Inc. All rights reserved.

1. Introduction

In electrical systems, the measurement of current, voltage and temperature in high voltage overhead transmission lines is very important and it requires special monitoring devices, which have to be completely isolated from the ground potential. Many optical techniques have been developed to perform this measurement using, for example, Faraday effect or magnetostrictive effect [1] for current, Pockels effect [2] for voltage, fiber Bragg grating (FBG) [3] for temperature and a light-emitting diode (LED) for leakage current detection on insulator strings [4].

Other way to measure these parameters in high voltage transmission lines is by using PoF (power over fiber) technique [5]. PoF consists in transporting optical energy to powering up electric or electronic devices remotely. PoF offers several advantages when it is used on high voltage environments, such as spark-free, lightning-proof, immunity to electromagnetic pulses, robust in harsh environments, such as, extreme temperatures, moisture, etc. Besides these advantages, the employment of a PoF scheme can replace the energy supplied by metallic cable and batteries located at remote sites, improving the reliability and the security of the system. One of the main benefits of the utilization of PoF technique in substations is the elimination of the need to run conductive copper wire into a high ground rise (GPR) zone. GPR can

cause severe interference problems in electronic equipment and systems [6]. Considering that, the sensor using PoF has a complete galvanic isolation to the ground potential and it is practically immune to the GPR effects. The PoF technique has already utilized to monitor current and temperature in high voltage [7–9].

An issue that arises when optical sensors have to be installed in the high voltage potential is how to guarantee that the optical cable stay on electrically passive for many years in operating. Although the optical fibers cables are non-conductive, they cannot be used at the high voltage potential using their regular coating materials because the optical cable would very quickly give rise to catastrophic tracking and erosion [10]. The fiber optic cable can conduct superficial leakage currents since it is exposed to environmental pollutants such as dust, smoke, saline atmosphere, etc [9]. In other words, it is necessary to use a special electric insulator to connect the optical fiber cable from the ground potential to the high voltage potential. The optical fibers have to pass through a hollow core insulator with an appropriated creeping distance. This solution is expensive and demands change of the ordinary insulator used in high voltage transmission lines.

We proposed in this work a new method to connect the optical fiber cable from the ground potential to the high voltage potential. In this approach, we used free space optics (FSO) to transmit and receive the optical signals from optical fiber placed in ground potential to the other one placed in the high voltage potential by using a pair of optical collimators. The collimators kit used in FSO avoids the changing of an ordinary insulator to one with embed-

* Corresponding author.

E-mail address: rosolem@cpqd.com.br (J.B. Rosolem).

ded fiber optic. This technique has already tested [11] using FBG in order to measure temperature in the high voltage transmission lines and the results are promising. In [11] it was demonstrated that the collimators alignment is very sensible to the angular tilt, but lateral misalignment originated from thermal effects can also affect the collimators alignment. These effects were also theoretically calculated in [12].

In this work, we use the techniques FSO and PoF to demonstrate this new concept, transmitting optical supply power to a remote unit placed in a simulated the high voltage potential and receiving data signals from it in the ground potential. In this demonstration, we used an ordinary Hall effect current sensor in the remote unit but any other electrical or electronic sensor could be used instead. Also we used a rigid insulator in order to avoid angular tilt effects and to maintain the stability of the transmission.

The technique evaluation was performed in a laboratorial prototype using 62.5/125 μm multimode fiber for the study of the sensitivity to optical alignment and the intrinsic loss of the collimators for the signal (1310 nm) and the powering (830 nm) wavelengths. Environmental tests were also conducted in order to demonstrate the performance of this technique in a real situation of application.

2. Description of the proposed PoF-FSO system

Fig. 1(a) shows the PoF/FSO system and its components for current sensing. Basically the system is constituted by the PoF control unit, a multimode 62.5/125 μm optical fiber that connects the PoF control unit to the collimator A (model F260APC-1550 from Thorlabs) installed on the base of an ordinary composite electrical insulator (simulated ground potential), a second collimator (B) installed at the top of the same electrical insulator (high voltage potential simulated), the PoF remote unit also installed at the top of the electrical insulator and the electronic current sensor. The insulator is a commercial rigid fiber glass/silicone structure (line post) made for use in 138 kV transmission lines. Fig. 1(b) shows details of the collimator B housing.

According we commented previously the collimators alignment is more sensible to the angular tilt, but using a rigid insulator only lateral misalignment originated from thermal effects can affect the collimators alignment. Indeed, the mechanical kit used to support the collimators pairs is deformed under effect of the external temperature. To mitigate this effect the material of the mechanical kit

is stainless steel. This material was chosen to ensure a low thermal expansion and at the same time a good resistance against environmental effects.

Fig. 2(a) shows in more details the elements of the PoF link: the PoF control unit containing a high power laser diode (HPLD – model 2486-L4) operating at 830 nm and an optical receiver, a PoF remote unit containing a GaAs photovoltaic converters (PV – model PPC-6E from JDSU), a rechargeable power supply (RPS), a microcontroller circuit, a 1310 nm Fabry Perot semiconductor laser (FPLD) and the Hall effect current sensor that is connected to the microcontroller circuit. The PoF link is bidirectional by using multimode 830/1310 nm muxes connected to each end of the fiber link (FO).

Although it is possible that the system works in a continuous operation (i.e. operation of the system without charging/discharging cycles), the loss of optical power caused by the FSO collimation process requires that the system operate in a non-continuous operation, such as described in [13]. The Fig. 2(b) presents the diagram of the PoF remote unit containing the RPS. A continuous optical power supply at the wavelength of 830 nm coming from the PoF control unit is injected in two commercial GaAs based photovoltaic converters (PV_1 and PV_2). We used a 50% splitter to divide this power in two parts. In order to make possible the operation of the sensor we introduced in the sensor circuit a super capacitor (C) (or an equivalent association of them) put it in parallel to the PVs. According to Fig. 2(b) a voltage comparator integrated circuit (LT6703-3) is used to turn on a voltage regulator integrated circuit (LT1764) when a specific voltage is reached in the capacitor. This specific voltage is defined by the voltage divider formed by the resistors R_1 and R_2 . When this voltage is reached, the comparator circuit enables the output of the regulator circuit, which supply the microcontroller circuit, and the laser driver circuit. The laser transmits the current sensor data in RS232 format using a low threshold 1310 nm Fabry-Perot laser. In the next section, we described the test results of this system.

3. Test results and discussion

The setup shown in Fig. 1(a) was built in order to determine the main parameters that influence the performance of the system. We used a commercial 1–1000 A analog Hall effect current prior as a current sensor. This sensor was connected to an input of the micro-

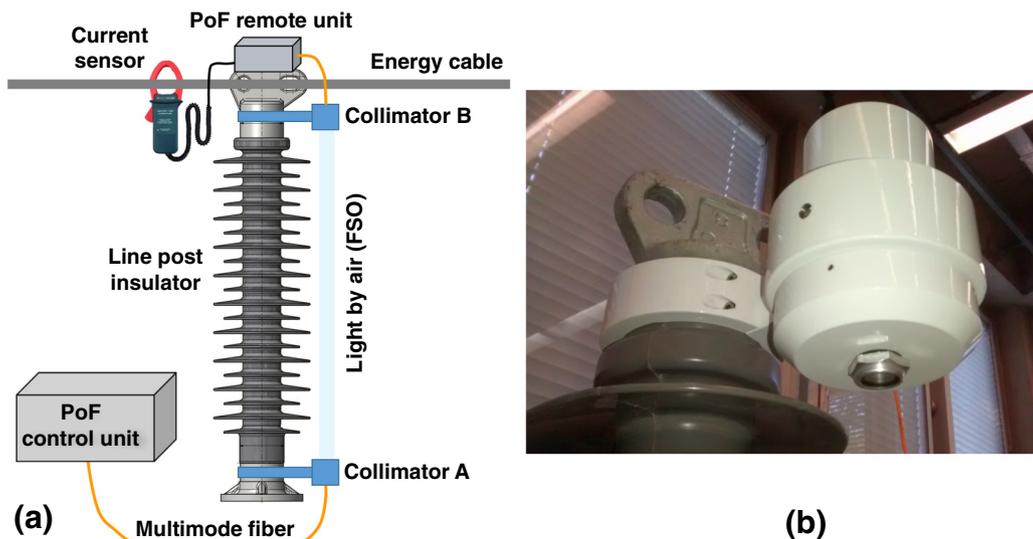


Fig. 1. The proposed POE-FSO system: (a) simplified view and (b) details of the collimator B housing.

متن کامل مقاله

دریافت فوری ←

ISIArticles

مرجع مقالات تخصصی ایران

- ✓ امکان دانلود نسخه تمام متن مقالات انگلیسی
- ✓ امکان دانلود نسخه ترجمه شده مقالات
- ✓ پذیرش سفارش ترجمه تخصصی
- ✓ امکان جستجو در آرشیو جامعی از صدها موضوع و هزاران مقاله
- ✓ امکان دانلود رایگان ۲ صفحه اول هر مقاله
- ✓ امکان پرداخت اینترنتی با کلیه کارت های عضو شتاب
- ✓ دانلود فوری مقاله پس از پرداخت آنلاین
- ✓ پشتیبانی کامل خرید با بهره مندی از سیستم هوشمند رهگیری سفارشات