

Architectural design of an advanced naturally ventilated building form

Kevin J. Lomas*

Institute of Energy and Sustainable Development, De Montfort University, Leicester LE1 9BH, UK

Received 3 April 2006; received in revised form 4 May 2006; accepted 24 May 2006

Abstract

Advanced stack-ventilated buildings have the potential to consume much less energy for space conditioning than typical mechanically ventilated or air-conditioned buildings. This paper describes how environmental design considerations in general, and ventilation considerations in particular, shape the architecture of advanced naturally ventilated (ANV) buildings. The attributes of simple and advanced naturally ventilated buildings are described and a taxonomy of ANV buildings presented. Simple equations for use at the preliminary design stage are presented. These produce target structural cross section areas for the key components of ANV systems. The equations have been developed through practice-based research to design three large educational buildings: the Frederick Lanchester Library, Coventry, UK; the School of Slavonic and East European Studies, London, UK; the Harm A. Weber Library, Elgin, near Chicago, USA. These buildings are briefly described and the sizes of the as-built ANV features compared with the target values for use in preliminary design. The three buildings represent successive evolutionary stages: from advanced natural ventilation, to ANV with passive draught cooling, and finally ANV with HVAC support. Hopefully the guidance, simple calculation tools and case study examples will give architects and environmental design consultants confidence to embark on the design of ANV buildings.

© 2006 Elsevier B.V. All rights reserved.

Keywords: Low energy buildings; Advanced natural ventilation; Ventilation areas; Case studies; Draught cooling

1. Background

The imperative of reducing the emission of greenhouse gases, and in particular CO₂, caused by the burning of fossil fuels has stimulated interest in the design of low energy buildings. In the 20 buildings monitored by Bordass et al., in the well known UK PROBE Studies [1] there was a factor of 6 difference in the CO₂ emissions produced for space conditioning and lighting a given floor area (Fig. 1). Nine of the 10 highest CO₂ emitters were air-conditioned (AC) or mixed mode (MM) (these used chilled beams, with displacement ventilation, etc. rather than full AC), and 9 of the 10 lowest emitters were naturally ventilated (NV) or advanced naturally ventilated (ANV). The term ‘advanced natural ventilation’ was coined to encompass buildings which utilised the stack effect to drive an air flow and so has been adopted for the buildings which are the subject of this paper. In the AC and mechanically ventilated buildings, the CO₂ emissions resulting from the fans and pumps required to move air (and

water and refrigerant) accounted for up to 50% of the emissions associated with space heating and cooling. Because AC buildings tend to be deep-plan, the CO₂ emissions for artificial lights were also substantial. Buildings which are particularly densely occupied, with long periods of usage and with high internal heat gains (e.g. from computers and other equipment) might justify the use of AC, but as the PROBE results show, some relatively lightly used buildings nevertheless had AC.

NV and ANV buildings utilise naturally occurring wind pressures, and/or the buoyancy force generated by internal heat sources, to drive an air flow, thereby avoiding the use of fans. Admitting cool night air into a building, to purge daytime heat accumulated in exposed thermal mass, can avoid the need for mechanical cooling entirely or, in warmer locations, reduce cooling loads, energy use and associated CO₂ emissions. Shallow-plans, which typify simple NV buildings, or the use of atria and lightwells in deeper-plan buildings, can improve the use of natural light reducing the CO₂ emission associated with artificial lighting.

Whilst global warming is seen as a treat to NV and ANV buildings, the overheating risk can be overstated. Current

* Tel.: +44 116 257 7961; fax: +44 116 257 7977.

E-mail address: klomas@dmu.ac.uk.

Annual CO₂ emissions in carbon units

Benchmarks 2000 ECON 19. CO₂ factors expressed as kgC/kWh: gas 0.052, electricity 0.127.
Heating normalised to 2462 degree days except C&W and Marston Warehouse

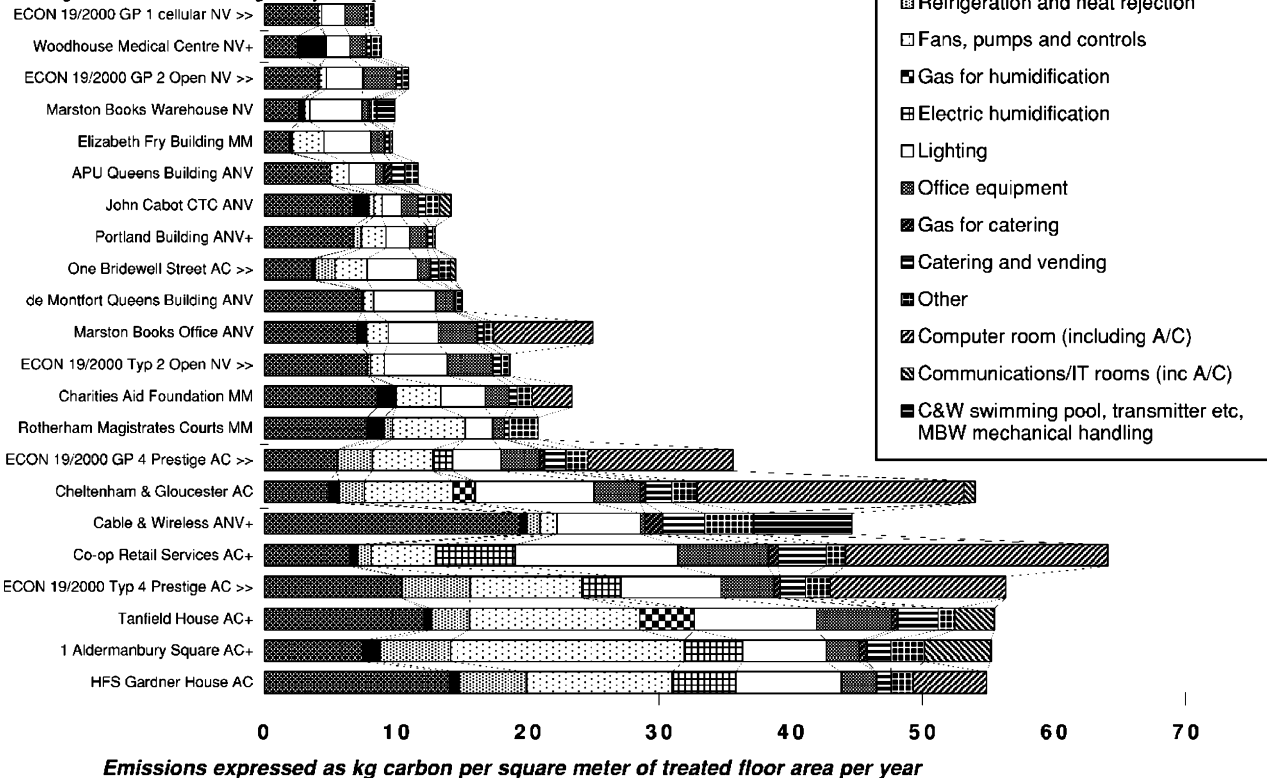


Fig. 1. The CO₂ emissions from 20 buildings and ECON19 [32] benchmarks.

evidence for the UK, although rather weak, suggests that ANV can keep buildings comfortable though the next century in all but the hottest (London) region [2,3].

Conventionally conceived NV buildings are shallow plan with an extended perimeter, and façade openings which provide the fresh air inlet and exhaust air outlet (Table 1). These features can be incompatible with the planning constraints imposed by tight urban sights and the noise and pollution in city centres. The use of manually operated windows can compromise security, increasing concerns about theft by building occupants (a particularly important consideration for library buildings of the type described in this paper). Mechanically controlled perimeter windows enable night ventilation but the building may then be vulnerable to break-in or other malicious acts.

At the design stage an ability to reliably predict the likely internal conditions in a building, for example by using dynamic thermal models and computational fluid dynamics programs, can be reassuring and it is important to have a clear idea of how the internal conditions in the finished building will be controlled. Relying, as they do, on variable and ill defined pressure differences set up across the building by the wind, the likely performance of simple NV buildings is hard to predict and control.

ANV buildings that utilise the stack effect, in which air warmed by internal sources of heat drives the air flow, do not necessarily rely on wind pressures. If properly designed and

controlled, an air flow can be assured at all times when there is an internal source of warmth, including at night. In fact, in an unconstrained displacement flow regimen, where heat sources generate isolated plumes of warm air, the flow rate is directly proportional to the strength of the source, and the interface between the cooler air the warm air above remains fixed [4]. With heat sources distributed over a surface, the air flow is also dependent on the source strength in steady state conditions [5]. This happy coincidence, between heat input and air flow rate, enables rather simple but robust control of air flow and makes prediction of performance at the design stage comparatively reliable. Further, the interface between the cool and warmer air can be designed to lie above head height.

The benefits of control-ability and predictability, which stack driven natural displacement ventilation offers, can be lost if wind pressures begin to dominate the flow. An inability to harness these pressures is not a disadvantage; after all it is during still warm summer conditions when it is most difficult to keep ANV buildings thermally comfortable. Therefore, designing the buildings to be 'wind neutral' is a useful guiding principle.

In a recent paper [2] a taxonomy was proposed, in which stack ventilated buildings were divided into four main types (Fig. 2). The edge-in, centre-out approach (E-C) is exemplified by the Queens Building at De Montfort University, Leicester, UK [6–9] and the edge-in, edge-out strategy (E-E) by the UK Building Research Establishment's (BRE) Energy Efficient Office of the Future [10].

متن کامل مقاله

دریافت فوری ←

ISIArticles

مرجع مقالات تخصصی ایران

- ✓ امکان دانلود نسخه تمام متن مقالات انگلیسی
- ✓ امکان دانلود نسخه ترجمه شده مقالات
- ✓ پذیرش سفارش ترجمه تخصصی
- ✓ امکان جستجو در آرشیو جامعی از صدها موضوع و هزاران مقاله
- ✓ امکان دانلود رایگان ۲ صفحه اول هر مقاله
- ✓ امکان پرداخت اینترنتی با کلیه کارت های عضو شتاب
- ✓ دانلود فوری مقاله پس از پرداخت آنلاین
- ✓ پشتیبانی کامل خرید با بهره مندی از سیستم هوشمند رهگیری سفارشات